

## INSPECT, TEST AND RECONDITION AC SYNCHRONOUS MACHINES IN-PLACE

### 1. SCOPE

1.1 Intent. This work item describes the requirements for the Contractor to visually inspect, test, and recondition (clean, dry and varnish-treat) an alternating current (AC) synchronous generator or motor onboard a Coast Guard vessel.

1.2 Alternate terminology. The term machine, when used in this specification, shall imply a synchronous generator or motor.

### 2. REFERENCES

#### COAST GUARD DRAWINGS

None

#### COAST GUARD PUBLICATIONS

None

#### OTHER REFERENCES

American National Standards Institute (ANSI/EASA) AR100, 2010, Recommended Practice for the Repair of Rotating Electrical Apparatus

MIL-D-16791, Jan 1993, Detergents, General Purpose (Liquid Nonionic)

MIL-E-22118, Jul 1974, Enamel, Electrical-Insulating

MIL-I-24092/1, Sep 1993, Insulating Varnish, Solvent Containing, Air-Dry for Spot Patching and Emergency Repairs, Grades CA, Class 130 and 155 Thermal Class Requirements

### 3. REQUIREMENTS

#### 3.1 General.

3.1.1 Notification and documentation. Abide by the following rules for all inspections, tests, and cleaning operations specified herein.

3.1.1.1 Advance notice. Notify the Coast Guard Inspector at least 24 hours before performing each test, inspection, and cleaning operation.

3.1.1.2 Documentation. Submit a CFR after completion of each inspection and test, along with a completed copy of each applicable test data sheet.

3.1.2 Original equipment manufacturer's guidance. Adhere to the requirements, cautions, and warnings stated in the generator or motor manufacturer's instruction book during the performance of this work.

## SFLC STANDARD SPECIFICATION 3100

3.1.3 Protective measures. Furnish and install suitable covering to seal off and protect all non-affected surfaces/equipment and spaces in the vicinity of the work area against contamination during the performance of work. Upon completion of work, remove protective material and inspect for the presence of contamination. Clean all equipment and spaces, contaminated due to improper protection, to original condition of cleanliness.

### 3.1.4 Machine protection.

3.1.4.1 Particular care shall be taken so that no foreign materials or dust are allowed to lodge on the machine, particularly the collector rings (if so equipped). Ensure that supply air to the compartment is filtered to preclude entry of paint over spray, dust, and industrial grit.

3.1.4.2 For a machine with collector rings, absolutely no silicone or silicone based insulations, cables, paints, varnishes, laminates, tapes, compounds, rubber, greases, or other products shall be used within the air space of the collector rings. Mechanics using protective hand creams containing conductive or silicone materials shall not handle internal collector space parts, as even small amounts of silicone materials will cause greatly increased brush wear.

3.1.4.3 Take adequate security measures to ensure that foreign objects do not enter a machine at any time, as a small bolt, nut, or other object in the air gap may cause damage that could require weeks to repair. Small, loose objects shall not be permitted in the pockets of workers within the compartment while a machine is uncovered. Account for all tools and fasteners entering and leaving a machine. Protect each open machine with stock or temporary covers during periods when no shipboard work is actively in progress on the internals.

3.1.5 Lock out. For a medium voltage (greater than 1000 volts) machine, the associated circuit breaker or disconnect switch shall be locked out or removed from the switchboard in addition to being danger tagged. Padlocks shall be installed to physically prevent closure or reinstallation of the disconnecting means and for generators, the starting of the prime mover. Also ensure that appropriate grounding straps are installed.

3.1.6 Secondary power sources. Ensure that secondary power sources, such as off-line electronic insulation fault monitors, space heaters, resistance temperature detectors, and internal inspection lights, are secured prior to commencing work.

3.1.7 Technical representative. Provide the services of a Technical Representative (Tech Rep), who is familiar with AC synchronous machines and shall be present during the performance of this work. The technical representative shall be employed by a shop that is a member of the Electrical Apparatus Service Association (EASA) and that shop shall adhere to the association's standards, including ANSI/EASA AR100. Both the technical representative and the Coast Guard Inspector shall be present to witness the performance of all tests, inspections, and cleaning operations performed under this specification.

3.1.8 Shop work. Components that can be removed from the cutter through existing accesses or those created by other work items may be inspected, cleaned, and dried ashore. Protect removed components to prevent damage while in transit.

3.1.9 Power. When authorized by the work item, power for temporary shipboard equipment may be taken from the ship service electrical distribution system.

3.1.10 Water and air. When authorized by the work item, hot and cold potable water and compressed tool air may be obtained from shipboard systems. A backflow preventer must be installed between each shipboard potable water connection point and the Contractor's equipment. Tool air that is to be blown into a machine shall be filtered for particulate, water, and oil prior to discharge.

## SFLC STANDARD SPECIFICATION 3100

3.2 Pre-cleaning procedures. Prior to performing cleaning requirements, accomplish the following:

3.2.1 Access cover removal. Remove, clean, and retain all machine access covers and fasteners.

3.2.2 Air gap clearances. Measure all main pole air gap clearances as follows, ensuring that the amount of removed varnish is kept to a minimum, and varnish residuals from the iron on the stator and the iron on the rotor are removed, wherever measurements will be taken:

- Choose and non-destructively mark the centerline of each main pole on both ends (fore and aft), as well as a single point on each end of the stator.
- Align the mark on the stator with the mark on the number one main pole (arbitrarily chosen). Carefully measure the air gaps with a tapered feeler gauge to the nearest thousandth of an inch; record the readings in the “Main Pole” section, “A” columns (Fore and Aft) of the DATA SHEET 1 (Air Gap Readings) provided herein.
- Repeat the above procedures, until the mark on the stator has been aligned with the marks on each of the remaining main poles.

3.2.3 Disassembly and inspections. Disassemble the machine, and accomplish the following inspections:

3.2.3.1 Visual inspections. Perform a visual inspection of the machine components, for the presence of contamination by dust, dirt, moisture, oil, and foreign matter (carbon, copper, and mica). Attempt to determine the origin, such as leaking seals, or any unusual conditions prior to the start of cleaning. Note all abnormal conditions on the stator, rotor, windings, and risers, and if installed, brushless exciter, diodes, collector rings, brush holders, brushes, and brush holder springs. Carefully examine the interior of the machine for loose objects such as, nuts, tools, cleaning rags; remove all such items. Inspect all electrical connections for tightness. Check all wedges, bands, and soldered connections and correct any minor deficiencies. Check for evidence of overheating, both general and localized. Record all findings, including the types of contaminants (oil, water, carbon, dirt, etc.) found.

3.2.3.2 Brush removal. If installed, remove and retain all brushes. Brushes with any of the following characteristics shall be replaced with new brushes:

- Worn or chipped to such an extent that they will not move properly in their holders.
- Damaged shunts, shunt connections, or hammer clips.
- Worn to one-half or less of the original length of the brush

3.2.3.3 Initial insulation resistance test. Measure and record the insulation resistance of each circuit listed in Table 1A through 1D below, as applicable. Apply a test voltage of 500 VDC for all circuits except the stator circuit on 2320, 4160 or 6600 VAC machines, which shall be tested at 1000, 2500 or 5000 VDC, respectively. Test six phase stators as two independent three-phase windings. Temperature correct all insulation resistance readings to 25°C using the nomograph of Figure 1. Record uncorrected insulation resistance reading, winding temperature, and corrected insulation resistance for each measurement taken. The following formula can be used as a cross check on the nomograph temperature correction:

$$R_{25} = R_T 10^{0.0305(T-25)}$$

where	$R_{25}$	is the corrected insulation resistance
	$R_T$	is the uncorrected insulation resistance
	$T$	is the winding temperature (°C)

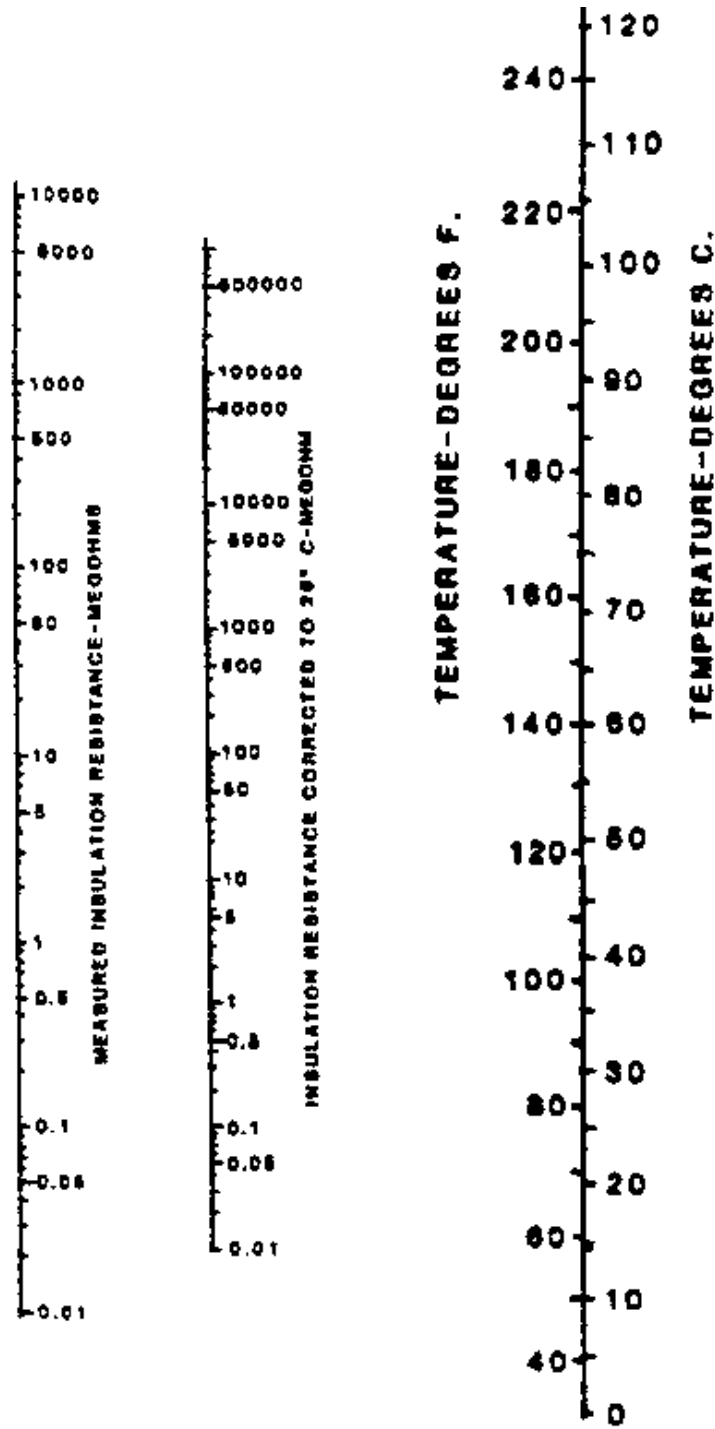


FIGURE 1 – INSULATION RESISTANCE TEMPERATURE CORRECTION NOMOGRAPH

3.2.3.4 Insulation resistance polarization index (PI) test. Measure and record the PI tests as follows:

3.2.3.4.1 Measure and record the insulation resistances of the windings after applying the test voltage specified in paragraph 3.2.3.3 above for one minute. Separately test the main field and stator windings. Apply rotor voltage between the copper conductors and the rotor structure to eliminate the insulating effect of the bearing lubricant film.

SFLC STANDARD SPECIFICATION 3100

3.2.3.4.2 If the value of the one minute insulation resistance is between the values shown in Table 1A through 1E below, as applicable, continue applying test voltage until a steady state value is reached. Measure and record the insulation resistance each minute during the test and more frequently when results are changing quickly. Plot the insulation resistance as a function of time on log-log paper for each winding tested. A PI value of less than 2.0 indicates that the windings are moist or dirty.

**TABLE 1A – POLARIZATION INDEX APPLICABILITY FOR 450 VAC GENERATORS**

Windings	Minimum Resistance	Maximum Resistance
Stator	0.2 MΩ	125 MΩ
Field	0.4 MΩ	125 MΩ

**TABLE 1B – POLARIZATION INDEX APPLICABILITY FOR 700 VAC MAIN PROPULSION GENERATORS (POLAR)**

Windings	Minimum Resistance	Maximum Resistance
Stator	0.3 MΩ	102 MΩ
Field	0.4 MΩ	150 MΩ

**TABLE 1C – POLARIZATION INDEX APPLICABILITY FOR 2320 VAC MAIN PROPULSION MOTORS (HEALY)**

Windings	Minimum Resistance	Maximum Resistance
Stator	0.8 MΩ	313 MΩ
Field	0.4 MΩ	150 MΩ

**TABLE 1D – POLARIZATION INDEX APPLICABILITY FOR 4160 VAC CENTRAL POWER PLANT GENERATORS (MACKINAW)**

Windings	Minimum Resistance	Maximum Resistance
Stator	1.6 MΩ	605 MΩ
Field	0.4 MΩ	150 MΩ

**TABLE 1E – POLARIZATION INDEX APPLICABILITY FOR 6600 VAC CENTRAL POWER PLANT GENERATORS (HEALY)**

Windings	Minimum Resistance	Maximum Resistance
Stator	2.5 MΩ	924 MΩ
Field	0.4 MΩ	150 MΩ

3.2.3.5 Winding cold resistance test. Measure the resistance of each winding at ambient temperature. Take measurements with a four wire micro-ohmmeter or other precision low resistance measuring device. Record the resistance and temperature of each winding shown in Table 1A or 1B above. Compare results with manufacturer’s design data. Retain readings for use during drying by circulating current in section 3.3.1.3.2 below.

## SFLC STANDARD SPECIFICATION 3100

3.2.3.6 Bearing wear. When specified by the work item, measure and record bearing wear. Temporarily support the rotor while a bearing is removed for measurement. For each bearing wear measurement, also record the manufacturer's acceptable range of values. Circle any measured values that are outside the manufacturer's acceptable tolerances.

3.2.3.7 Collector ring wear and concentricity. When specified by the work item, measure and record collector ring wear and concentricity. Note any corrosion or abnormal wear patterns. Also record the manufacturer's acceptable collector ring runout. Note locations (relative to a reference point) on the collector ring where runout is excessive.

### CAUTION!

**For a Caterpillar SR4 series generator, the permanent magnet pilot exciter armature stator must be removed prior to rigging out the rotor. Observe the removal and reinstallation instructions in Caterpillar form SENR3985, typically included in the manufacturer's instruction book.**

3.2.3.8 Rotor removal. When specified by the work item, remove and support the rotor such that the windings bear no weight. Follow the machine manufacturer's recommended rigging procedure, including removal of the brushless exciter (if so equipped). Prior to disassembly, measure the coupling angular and parallel alignment and match mark for later reconnection.

3.2.3.9 Cleaning methods. Sequentially employ all of the following methods for cleaning the machine:

3.2.4 Suction. Use suction to remove abrasive particles such as loose grit, iron dust, carbon and copper particles.

3.2.5 Compressed air. Use compressed air with suction such that material dislodged by the air stream will be captured and exhausted. Remove dry loose dust and foreign particles, particularly from inaccessible locations such as air vents in the rotor punchings. Ensure the following:

- The compressed air is clean (oil free with the use of an oil filter) and dry.
- The air pressure does not exceed 30 pounds per square inch.
- The machine is opened from both ends, to allow a path of escape for air and dust.
- Extreme caution is used when using compressed air, particularly if abrasive particles are present.

3.2.6 High pressure water spray. After removal of loose materials above, clean all windings and interior parts of the machine with a hot non-ionic liquid detergent solution as described below. The use of solvents that are not dissolved in water is strictly prohibited.

3.2.6.1 Waste containment. Install temporary containments and plastic sheeting as needed to confine all liquids to the machine interior and collect them for disposal. Dispose of all cleaning, rinse, and waste solutions in accordance with applicable local, regional, state, and federal laws and regulations. No fluid shall be allowed to flow into the bilge or public drains.

3.2.6.2 Temporary ventilation. Install temporary ventilation to exhaust airborne moisture from the compartment during the cleaning operation.

3.2.6.3 Pressure washer. Set up a hot pressure washer capable of delivering at least 0.5 gallons per minute through an adjustable pressure range up to 2500 psig. The equipment shall be of the airless design, i.e., the cleaning solution is atomized by high fluid pressure at the spray nozzle tip and requires no air

## SFLC STANDARD SPECIFICATION 3100

supply. Observe all spray equipment manufacturer's recommended safety practices. Furnish all personnel in the compartment during the cleaning (including the Coast Guard Inspector) with the personnel protective equipment necessary to work near the hot and alkaline cleaning solution.

3.2.6.3.1 Before its first use, the water spray equipment shall be cleaned and purged of any dirt or debris in the system. Follow the manufacturer's instructions on initial flushing of the system.

3.2.6.3.2 The cleaning solution shall consist of liquid non-ionic water soluble general purpose detergent, meeting the requirements of MIL-D-16791, mixed in a proportion of 1 ounce of concentrate to 1 gallon of fresh water. If the cleaning solution is batch prepared, heated the mixing water to 130°F to 150°F prior to dissolving the detergent. If the cleaning equipment is designed to continuously prepare solution (concentrate is siphoned into the cleaning unit), demonstrate that the mixing ratio is properly set to the Coast Guard Inspector. In cold weather, the concentrate may need to be kept warm to prevent undesirable viscosity changes.

3.2.6.3.3 With the pressure washer ready for use, perform a test run (need not be in the compartment) by discharging spray into a bucket or other suitable container. Adjust the spray pattern to obtain a wide fan shaped distribution. Set the sprayer controls to avoid damaging the insulation by limiting winding impingement pressure to 30 psig. Cleaning and rinse solution temperature shall be no less than 140°F and shall not exceed 194°F.

3.2.6.3.4 Spray the machine internals until all carbon dust, oil, grease, and foreign deposits are removed. Ensure that all coils, windings, and structural members are thoroughly cleaned. Avoid striking varnished surfaces with the cleaning nozzle or wand. Use clean lint-free cloths to check for cleaning effectiveness. At the conclusion of a wash cycle, rinse the windings using hot fresh water. Do not let cleaning solution dry on machine surfaces. Continue wash and rinse cycles until the machine is clean. The final rinse of the day shall include all machine internals to ensure that any overspray is completely removed from all surfaces.

3.2.6.3.5 Wipe off accessible wetted surfaces and blow dry or wet vacuum any remaining surface water. Visually inspect the windings for cleanliness and damage.

3.3 Post-cleaning procedures. Perform the following post cleaning procedures:

3.3.1 Drying. Accomplish drying by the following methods:

### NOTE

**Drying cannot be hurried; past performance has shown that a week or longer may be needed for satisfactory results. A large machine is often difficult to dry satisfactorily when only external heating is used. Typically after several days of external heating, low voltage direct current must be circulated through the windings to complete the drying process.**

3.3.1.1 Insulation resistance measurements. Readings shall be taken (see Section 3.2.3.3 above) when the drying is started, checked at regular intervals thereafter as long as the drying continues, and plotted on semi-logarithmic paper with the logarithm of insulation resistance ordinate and time as abscissa.

**NOTE**

The degree to which the properties of insulation are restored by drying may be determined to some extent by measuring the insulation resistance to ground. Usually the resistance will drop as the machine warms up, reach a minimum, and then start to rise rapidly at first and then more slowly as the drying progresses. The value may decrease slightly at times and then increase again at a slower rate as the moisture is driven out, indicating that the drying is nearly completed. An erratic curve may indicate leakage paths to ground or weak insulation. As drying continues, the general trend of the insulation resistance values indicate the progress in eliminating moisture.

3.3.1.1.1 Drying shall continue until either the insulation resistance readings show no abrupt changes and do not increase more than 5% over a 12-hour period or the polarization index is greater than 3.0.

3.3.1.1.2 The final machine winding insulation resistances at the completion of drying, adjusted to 25°C, shall not be less than the values in Table 2 below or those measured during the pre-cleaning test, whichever is greater.

**TABLE 2 – MINIMUM POST-DRYING WINDING INSULATION RESISTANCES**

Windings	Minimum Insulation Resistance (MΩ) for Machine of Rated Voltage (VAC)			
	450	700	4160	6600
Stator	1.0	1.4	8.1	12.3
Field	2.0	2.0	2.0	2.0

3.3.1.2 External heat. Fabricate a temporary oven, using any variety of materials such as heat-insulation panels secured to suitable frames, for the application of external heat. External heaters shall be kept away from any material that may burn or melt. Ensure that the heat is uninterrupted to avoid cooling and subsequent condensation of moisture. If steam is used, ensure there are no leaks, which might introduce moisture into the enclosure or machine.

**NOTE**

The heater power rating will vary with the amount of equipment to be dried, degree of enclosure, and ventilation airflow rate. It is, therefore, impossible to give a rigid rule for determining the exact size heater required. By assuming that the machine is composed entirely of  $w$  pounds of steel, the energy ( $E$ ) in kWh required to heat the machine from ambient ( $T_1$ ) to baking temperature ( $T_2$ ) can be estimated as follows:

$$E = 3.5 w (T_2 - T_1) / 100,000$$

For every 1000 pounds of machine weight, 0.25 kW or 800 BTU/h is required to achieve a 140°F temperature rise in 20 hours. Since this calculation assumes that no heat is lost by radiation or by forced or natural convection, the power rating thus calculated should be increased by a few kilowatts to compensate for heat losses.



## SFLC STANDARD SPECIFICATION 3100

3.3.1.2.1 Blow filtered dehumidified heated air through the machine to remove moisture evaporated by the temporary oven and provide ample exhaust ventilation to expel the damp air. Verify that the temporary supply blower and its ductwork are clean prior to energizing the fan.

3.3.1.2.2 If practicable, periodically rotate the rotor to allow trapped water to escape and expedite the drying process.

3.3.1.2.3 Monitor the temperature of the equipment being dried by means of temperature detectors, permanently or temporarily installed, or by thermometers placed so that they may be easily read at the hottest spots on the equipment. Observe the machine manufacturer's temperature limits if more restrictive than those below. Ensure the following:

- Limit heat input so that winding temperatures do not increase more than 7°F per hour.
- Maintain temporary oven air temperature between 280 and 300 °F until the winding reaches a temperature of 220 to 230 °F (185°F for many Caterpillar machines).
- Thereafter, adjust the temporary oven air temperature to maintain the winding temperature at 220 to 230 °F (185°F for many Caterpillar machines) until the winding is dry.

3.3.1.3 Circulating currents. After removal of as much moisture as possible by external heating, circulate current throughout the windings from an external, low voltage, direct current source. Current shall not be circulated through any winding that has an insulation resistance of less than 50 kilohms at room temperature. Temporary sources (e.g., arc welder sets) shall be provided with means for adjusting the voltage to limit the current through the windings.

3.3.1.3.1 Current shall not be conducted into the rotor through brushes resting on stationary collector rings. To prevent localized heating of the collector rings, the rotor shall be rotated continuously by a temporary external prime mover (e.g., air motor) if it is necessary to dry by means of circulating current. If authorized by the work item, an installed prime mover (e.g., engine or barring gear) may be used to spin the rotor. If not grease lubricated, circulate lube oil to all affected bearings while the rotor is turning.

3.3.1.3.2 When drying by circulating current, the temperature must be increased slowly. Embedded temperature detectors or thermometers on the outside of the insulation will not indicate the hottest spot or copper temperatures. Temperatures measured by embedded detectors or by the hot resistance method (see paragraph 3.3.1.3.3 below) shall not exceed 195°F (185°F for many Caterpillar machines). Temperatures measured by thermometers shall not exceed 170°F.

3.3.1.3.3 Winding hot resistance temperature is determined by comparison of the hot winding resistance with the cold winding resistance measured in paragraph 0above. A high accuracy instrument, such as a Kelvin bridge shall be used. In the application of this method, accuracy is essential in the measurement of all resistance. The following formula shall be used to compute the temperature of copper conductors by the resistance method:

$$T_h = \frac{R_h}{R_c}(234.5 + T_c) - 234.5$$

where  $R_h$  is the hot insulation resistance  
 $R_c$  is the cold insulation resistance  
 $T_h$  is the hot winding temperature (°C)  
 $T_c$  is the cold winding temperature (°C)

3.3.2 Insulation treatment. After the equipment has been fully cleaned and dried, touch up thin and bare spots on the cleaned machine with an air drying varnish or insulating enamel as follows:

## SFLC STANDARD SPECIFICATION 3100

3.3.2.1 Protection. Protect adjacent equipment in the affected compartment from overspray. Ensure that temporary ventilation is adequate to maintain a safe working environment within the space.

**NOTE**

**Aerosol spray cans of air dry varnish and insulating enamel are available and may be useful for small jobs where utilizing a spray gun is not cost effective. The propellant is a petroleum distillate so appropriate health and fire safety precautions should be taken.**

3.3.2.2 Application. Apply a clear, air-drying varnish (grade CA) that conforms to MIL-I-24092 to the rotor and field windings. Insulating enamel that conforms to MIL-E-22118 may be used for other insulated surfaces. Insulate to seal cracks, fill voids, and touch up damaged spots with one or two thin coats. Two coats are usually adequate for satisfactory protection. In no case shall more than three coats be applied. Films shall normally be sprayed on surfaces to be insulated; however, the application of air-drying films by brushing is acceptable.

3.3.2.3 Drying. The drying time to be allowed for each of the coats depends to a large extent upon the atmospheric conditions. The first coat of a two-coat application shall be allowed to dry until tack-free, but not more than 24 hours. The final coat shall be allowed to dry at least twice the time required for the material to reach a tack-free condition. Accelerated drying is permitted but in no case shall the temperature of the work be allowed to exceed 158° F.

3.3.3 Post-cleaning insulation resistance. Measure and record the insulation resistances (see Section 3.2.3.3 above) of the windings listed in Table 3 below. If the final machine winding insulation resistances after the varnish cures, adjusted to 25°C, are less than the values in Table 3 below or those measured during the pre-cleaning test, whichever is greater, submit a CFR.

**TABLE 3 – MINIMUM POST-VARNISHING WINDING INSULATION RESISTANCES**

<b>Windings</b>	<b>Minimum Insulation Resistance (MΩ) for Machine of Rated Voltage (VAC)</b>			
	<b>450</b>	<b>700</b>	<b>4160</b>	<b>6600</b>
Stator	25.0	20.5	121	185
Field	25.0	30.0	30.0	30.0

3.3.4 Final insulation resistance polarization index test. Upon completion of cleaning and varnish treatment, repeat the insulation resistance PI tests of Section 3.2.3.3 above. If the PI is less than 3.0, submit a CFR.

3.4 Reassembly. Reassemble the machine after all tests and inspections have been accepted by the Coast Guard Inspector.

3.4.1 Alignment. If the rotor was uncoupled in paragraph 3.2.3.1 above, reinstall the rotor and brush rigging assembly or brushless exciter. Measure and record air gaps in accordance with Section 3.2.2 above.

3.4.1.1 Shaft coupling. Reconnect the shaft coupling. Measure and record shaft coupling angular and parallel alignment readings. Adjust as necessary to within the manufacturer's recommended angular and parallel alignment tolerances. If no manufacturer's data is available, angular misalignment shall not exceed 0.005 inch and parallel misalignment shall be no greater than 0.002 inch.

## SFLC STANDARD SPECIFICATION 3100

3.4.1.2 Bearing lubrication. Ensure that machine bearings are properly lubricated. Slowly rotate the assembled machine using the barring gear or turning motor. Verify that air gap is adequate to prevent mechanical contact of the rotor coils with the stator through at least one complete revolution.

3.4.1.3 Brush holders. If so equipped, all brush holders shall be the same distance from the collector rings, not more than 1/8-inch, nor less than 1/16 inch, unless otherwise specified by the manufacturer.

3.4.2 Brush installation. If so equipped, install retained or replacement brushes into the brush rigging assembly. After the brushes have been installed, check and ensure the following:

- Brushes are free to move in the brush holder without sticking.
- Brush tension is adjusted in accordance with manufacturer's recommendations. If no data is available, adjust brush tension to 2½ pounds per square inch of brush cross sectional area.
- The shunt terminals are firmly attached to the brush holders.

3.4.3 Reinstall the cleaned machine access covers and any other removed equipment. Reuse retained fasteners.

3.4.4 Space heater. Energize the machine space heating system to exclude moisture whenever the unit is not in operation.

3.5 Operational test. Ship's force will operate all machinery during the sea trials and operational tests. Prior to testing, remove grounding straps and locks that were installed in paragraph 3.1.4 above and reinstall the machine circuit breaker if it was racked out or removed.

3.5.1 Dock trial. A dock trial shall be performed to verify that the machine affected by this item is operating satisfactorily. Operate at full power using ship's loads for at least one hour. For a main propulsion machine or thruster generator, rig additional mooring lines and limit propeller rotational speed to prevent the ship from pulling away from the dock. Take appropriate precautions on the cutter and nearby ships to prevent fouling of seawater piping systems if bottom sediment may be stirred up by the propeller.

3.5.2 Sea trial. A sea trial shall be performed, if necessary, to complete full power testing of a main propulsion machine or thruster generator. For a main propulsion generator or motor, perform a full power trial in accordance with the cutter's maintenance procedure card. Other tests may proceed concurrently as conditions allow.

3.6 Final insulation resistance. While still hot after the load test or sea trials, measure and record the insulation resistance of the stator and rotor circuits (see paragraph 3.2.3.3 above).

3.7 Post sea trial inspection. After the sea trial, visually inspect the machine internals for evidence of overheating, loose fasteners, collector rings problems, broken brushes, and other applicable conditions recommended by the technical representative.

## 4. NOTES

4.1 Polarization index test. Polarization index (PI) is the ratio of the 10-minute insulation resistance value to the 1-minute insulation resistance value. The change in insulation resistance with the duration of the test potential application is useful in appraising the cleanliness and dryness of a winding. Insulation

## SFLC STANDARD SPECIFICATION 3100

resistance of a winding will normally increase with the duration of the test voltage. The measured insulation resistance of a dry winding in good condition will reach a fairly steady value in 10 to 15 minutes. If the winding is wet or dirty, the steady value will usually be reached in 1 or 2 minutes. The slope of the curve (typical winding shown in Figure 2 below) is an indication of insulation condition.

4.2 Medium voltage machines. Medium voltage (greater than 1000 volts) machines are totally enclosed, ventilated with filtered and recirculated water-cooled air; they should rarely, if ever, require cleaning. Cleaning should not be undertaken without Coast Guard electrical engineering review and analysis of machinery history records, including insulation resistance trend graphs.

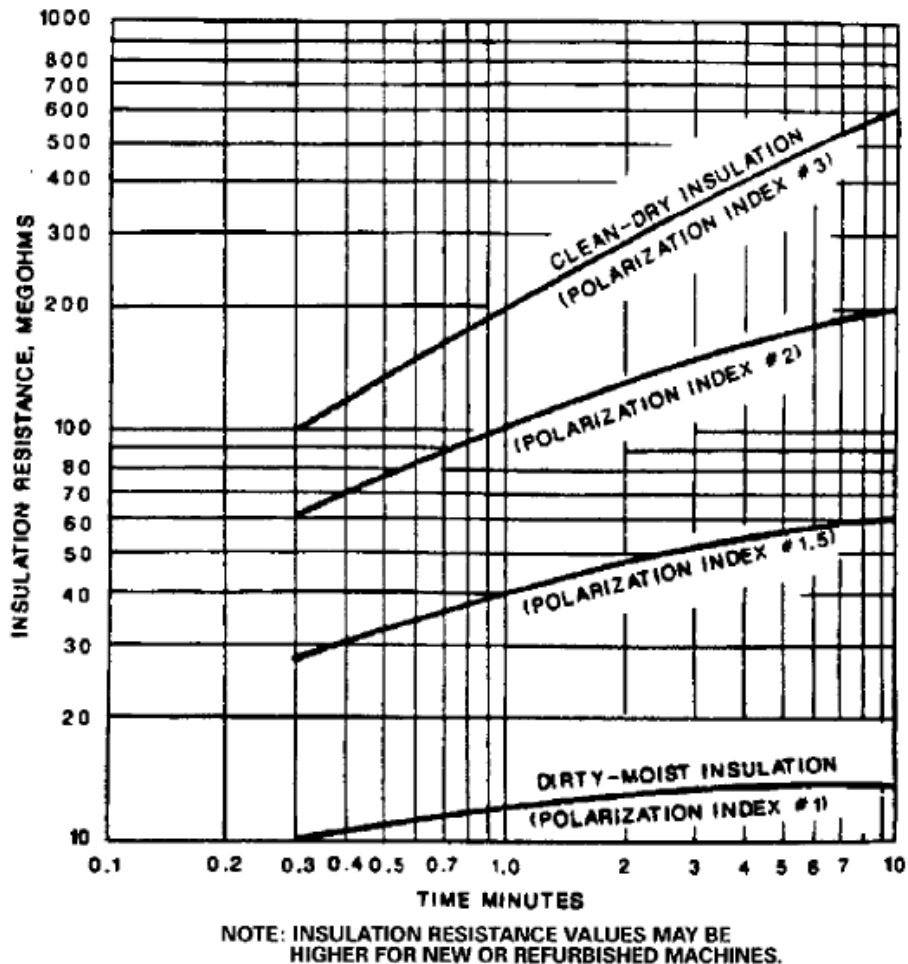


FIGURE 2 – VARIATIONS IN INSULATION RESISTANCE WITH TIME FOR A TYPICAL WINDING

4.3 Sources of supply:

- Air drying varnish: Dolph AC-41, ER-41, or AC-43  
John C. Dolph Company ([www.johncdolph.com](http://www.johncdolph.com))  
320 New Road, P.O. Box 267  
Monmouth Junction, NJ 08852  
(732) 329-2333
- Air drying insulating enamel: Glyptal 1201 or 1201A  
Glyptal, Inc. ([www.glyptal.com](http://www.glyptal.com))  
305 Eastern Avenue  
Chelsea, MA 02150  
(800) 457-1201

SFLC STANDARD SPECIFICATION 3100

DATA SHEET 1 – AIR GAP READINGS

VESSEL NAME: _____		Generator/Motor No. _____						
HULL#: _____		Serial No. _____						
POLE NO.	FORE		AFT					
	*A	**B	*A	**B				
1								
2								
3								
4								
5								
6								
7								
8								
9								
10								
11								
12								
13								
14								

\*Column A is for recording of preliminary air gap clearances.  
 \*\*Column B is for recording of post-installation air gap clearances.

	NAME (Type/Print)	SIGNATURE	DATE
Contractor			
Test conductor			
USCG Inspector			
Ambient conditions:			